



InterAgency Review Council

Susan J. Hibbard, Chair
IARC
P.O. Box 64975
St. Paul, MN 55164
(651) 296-8066


Lorna K Girard, Chair
IARC Ventilation
90 West Plato Boulevard
St. Paul, MN 55107
(651)296-1591

Ventilation Committee

MN IARC CKV committee, Spring, 2001

General Ventilation Criteria Flow Chart

TJ

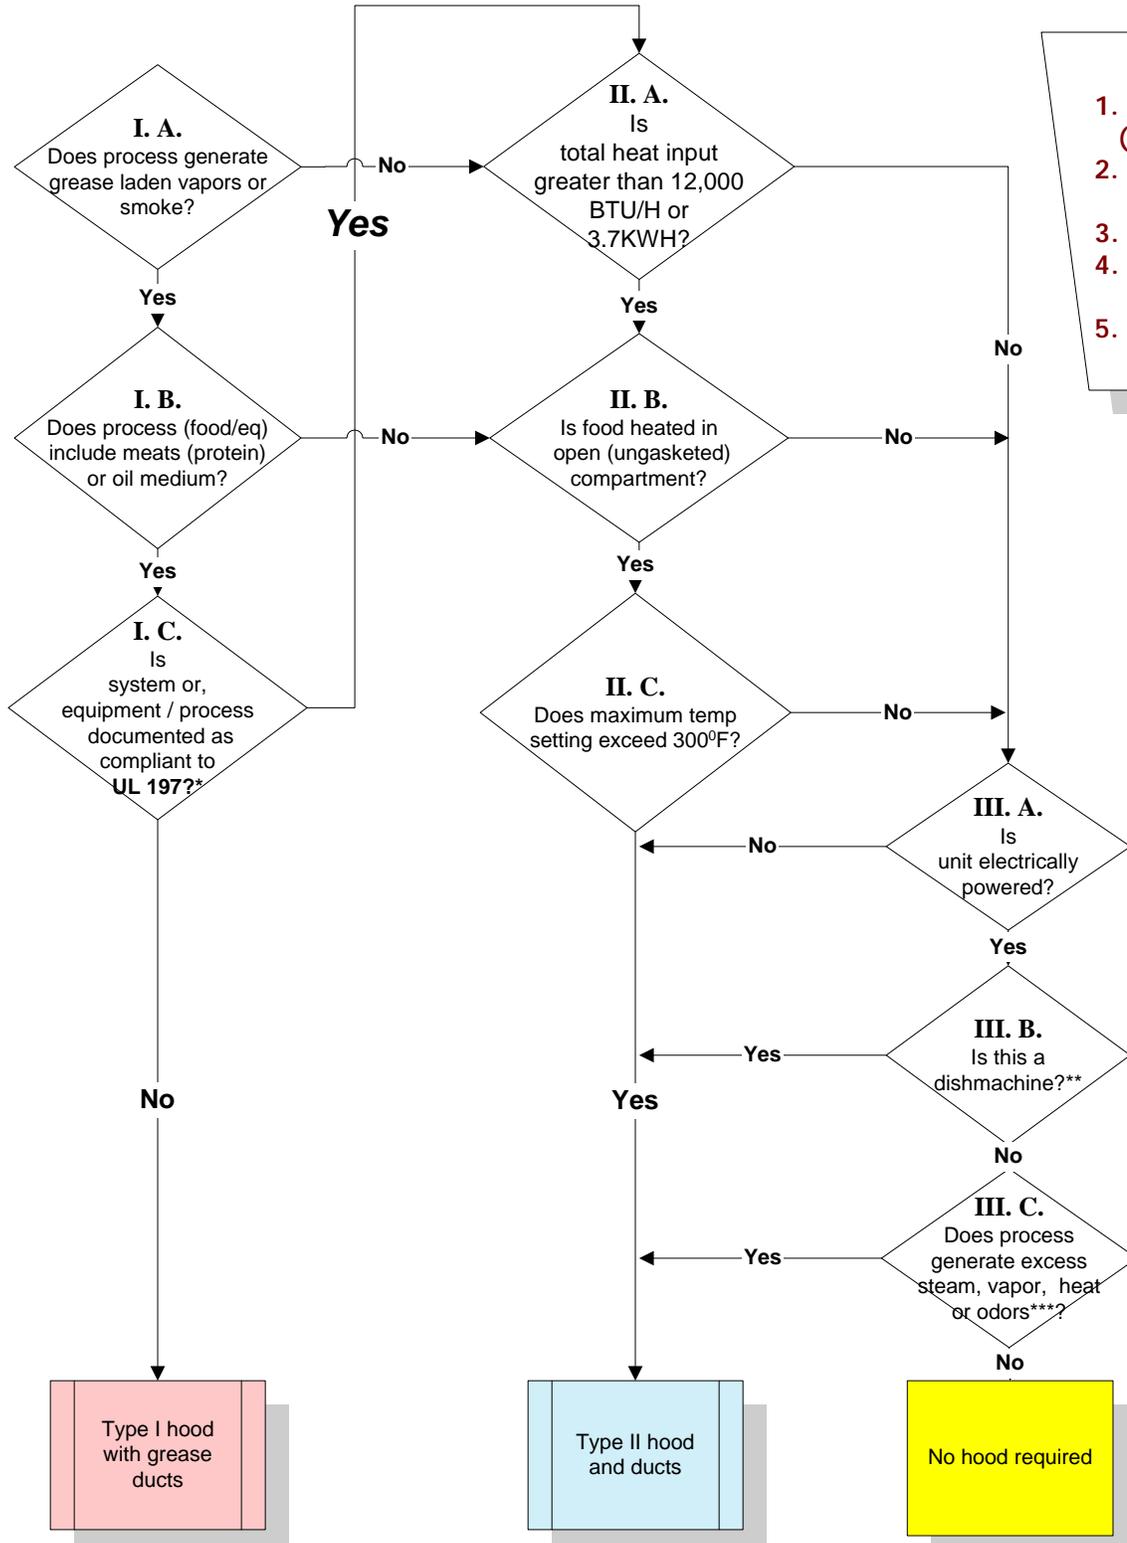

Other Criteria:

1. Menu/volume (food and equip)
2. Temperatures and heat gain
3. Type of fuel
4. Method of heat transfer
5. Space, HVAC rates, % fresh air (outside)

* UL 197 eighth edition, includes EPA 202 and NFPA 96 ('94)chapt. 10

** Undercounter dish machines do not require hoods.

*** Comparable amounts relative to other low to medium temp cooking equipment such as fryers, griddles, ovens, dish machines, etc.